


Koaxialsonde


Produktspezifikation

Modell	PV1-H-H $\varnothing 4,2 \times 44,5$
Material	Messing
Empfohlene Reise	2,0 mm (140 g)
Volle Reise	8,6 mm (760 g)
Mindestbestellmenge	100 Stück

Produktzeichnung

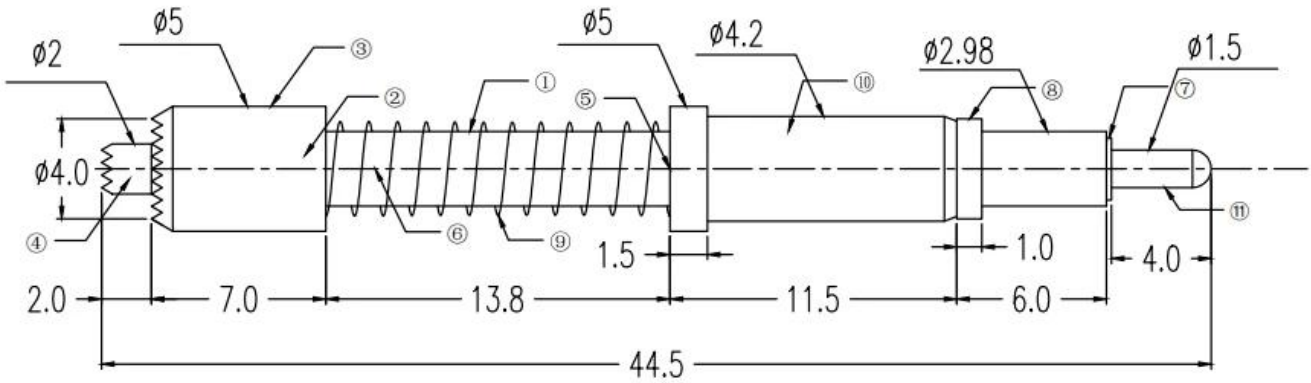

Unternehmensprofil

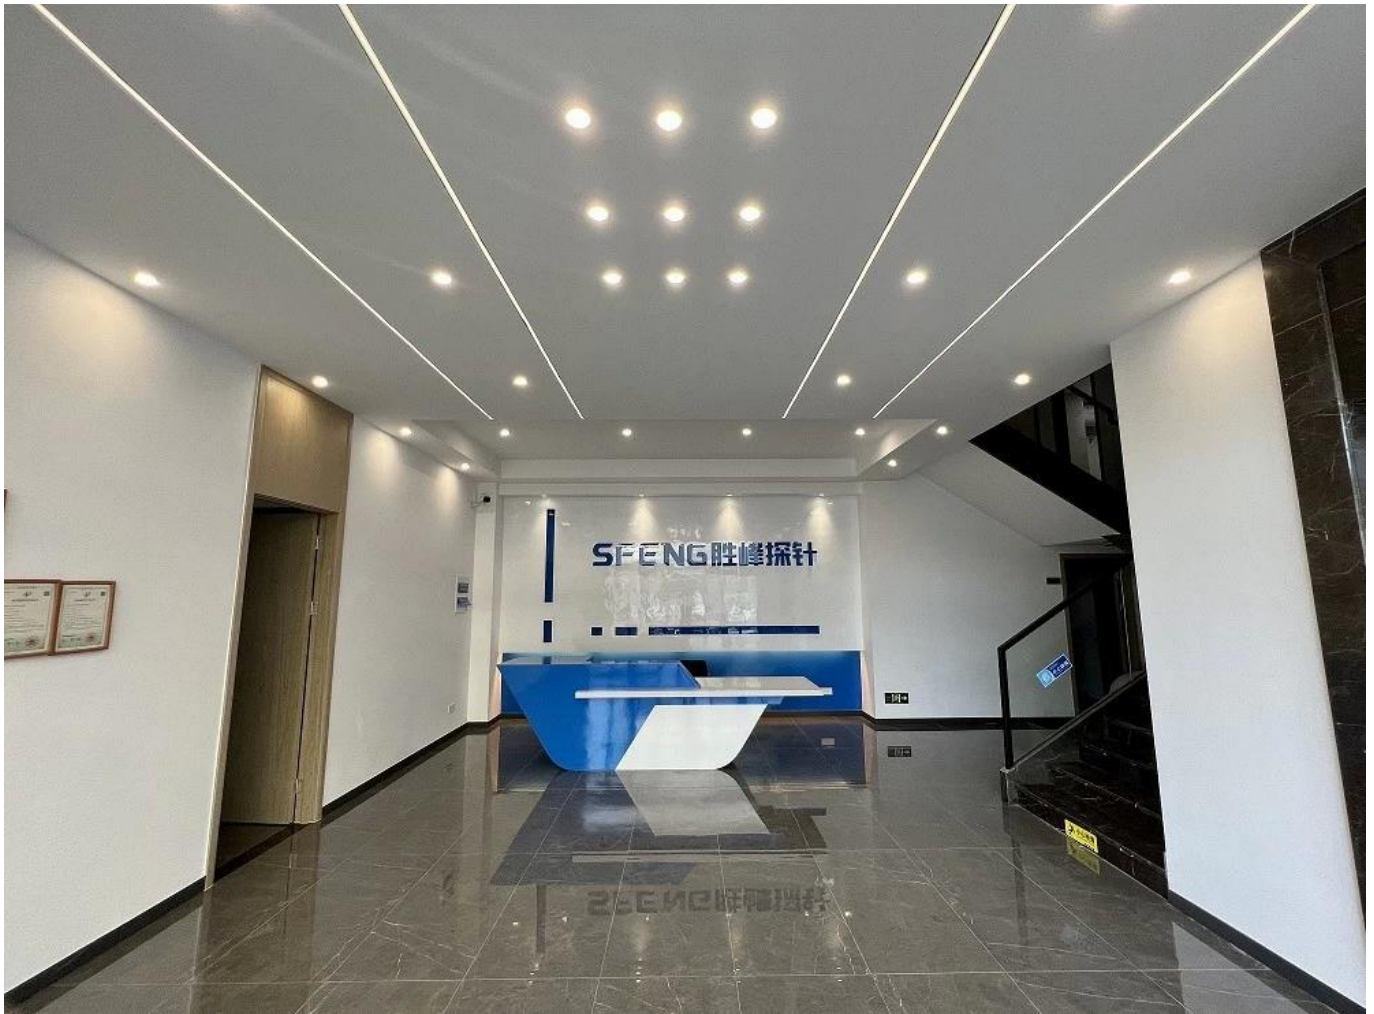

Suzhou Shengyifurui Electronic Technology Co.,Ltd ist der führende Hersteller von Prüfspitzen in China. 1984 gründeten wir die erste Fabrik in der Stadt Cixi, Provinz Zhejiang. Mit hoher Qualität und süßem Service sind unsere Produkte in mehr als 50 Ländern der Welt weit verbreitet. Wir sind bestrebt, der zuverlässigste Prüfspitzenlieferant auf dem chinesischen Markt zu sein. Wir sind bestrebt, unseren Kunden auf der ganzen Welt die professionellsten Produkte und Dienstleistungen anzubieten. Zu den Produkten gehören In-Circuit-Federprüfspitzen, Halbleiter-Federprüfspitzen, Batterielade-Pogo-Pins und das entsprechende Zubehör.

Produktionsfluss



1. raw material warehouse



2. Lathe workshop



3. Assemble workshop



4. Quality inspection



5. Finished products



6. Packing

FAQ

FAQ

1. What is terms of SFENG payment?

Usually, we require 100% payment before delivery. You can choose Wire transfer and Pay Pal. The currency we accept are USD dollar, Japanese Yuan and RMB. Payment term is negotiable for special order.

2. What is the lead time of orders?

SFENG can send standard probes products out within 3 days. For customized products, the lead time is 15-20 days depending on order quantity.

3.How does SFENG control product quality?

SFENG have skilled QC team and professional testing equipment. From raw material to finished products, we have complete checking process. Only approved products are allowed to deliver to customer.

4. Can customized products be accepted?

Yes, one biggest advantage of SFENG is product customization. Just telling us the parameter and function you need, our professional engineer will design product specially for you.

5.How does SFENG hand in case of a compliant?

Compliant seldom happen. Usually, we will find root case and take corrective measure within one week since receiving defective samples.