


Coaxiale sonde


Productspecificatie

Model	PV1-H-H $\varnothing 4,2 \times 44,5$
Materiaal	Messing
Aanbevolen reizen	2,0 mm (140 g)
Volledige reis	8,6 mm (760 g)
MOQ	100 STUKS

Producttekening

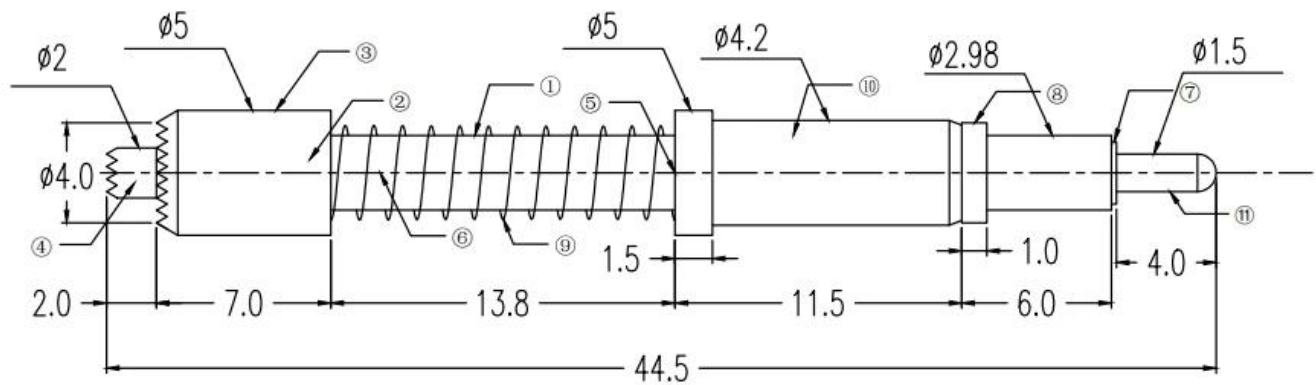

Bedrijfsprofiel

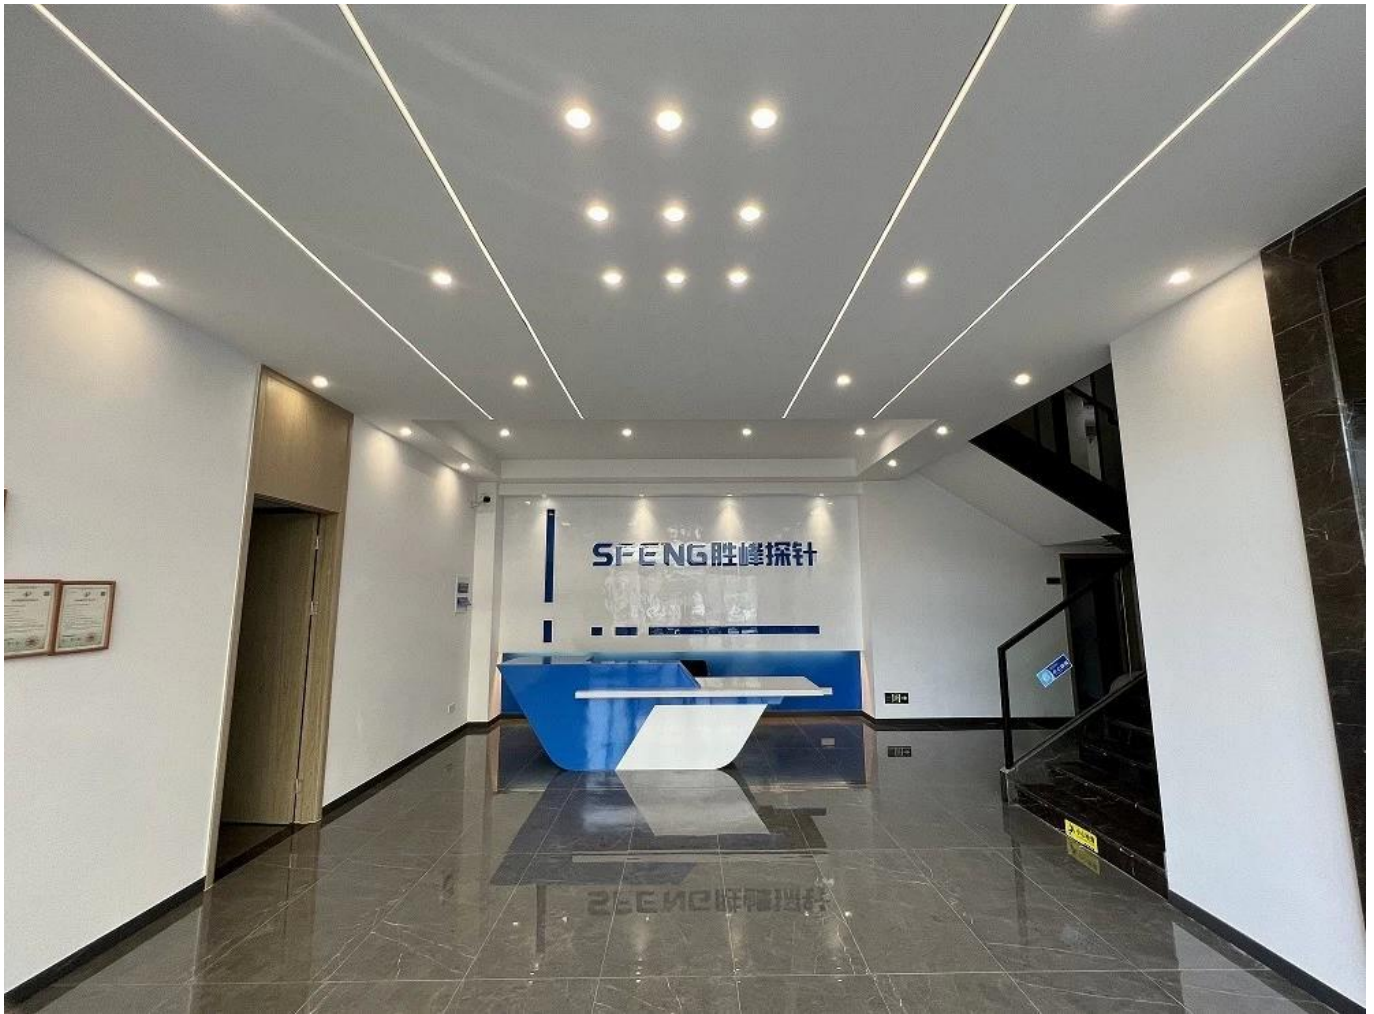

Suzhou Shengyifurui Electronic Technology Co., Ltd is de toonaangevende fabrikant van testsondes in China. In 1984 richtten we de eerste fabriek op in Cixi City, provincie Zhejiang. Met hoge kwaliteit en goede service worden onze producten op grote schaal gebruikt in meer dan 50 landen over de hele wereld. We streven ernaar de meest betrouwbare leverancier van testsondes op de Chinese markt te zijn. We streven ernaar om de meest professionele producten en diensten aan de klanten ter wereld te leveren. Producten omvatten in-circuit veertestsonde, halfgeleiderveertestsonde, pogo-pin voor het opladen van batterijen en de bijbehorende accessoires.

Productiestroom



1. raw material warehouse



2. Lathe workshop



3. Assemble workshop



4. Quality inspection



5. Finished products



6. Packing

FAQ

FAQ

1. What is terms of SFENG payment?

Usually, we require 100% payment before delivery. You can choose Wire transfer and Pay Pal. The currency we accept are USD dollar, Japanese Yuan and RMB. Payment term is negotiable for special order.

2. What is the lead time of orders?

SFENG can send standard probes products out within 3 days. For customized products, the lead time is 15-20 days depending on order quantity.

3.How does SFENG control product quality?

SFENG have skilled QC team and professional testing equipment. From raw material to finished products, we have complete checking process. Only approved products are allowed to deliver to customer.

4. Can customized products be accepted?

Yes, one biggest advantage of SFENG is product customization. Just telling us the parameter and function you need, our professional engineer will design product specially for you.

5.How does SFENG hand in case of a compliant?

Compliant seldom happen. Usually, we will find root case and take corrective measure within one week since receiving defective samples.